







- LEGEND**
-  OSD CONTROL SUMP WITH FLOW REGULATING DEVICE TO LIMIT PEAK DISCHARGE FLOW RATES TO SATISFY SHARE OF SITE OSD REQUIREMENTS
 -  GROSS POLLUTANT TANK FOR SCREENING OF DISCHARGE WATER PRIOR TO DISCHARGE TO WSD TANK
 -  STORMWATER QUALITY IMPROVEMENT DEVICE FOR TREATMENT OF WATER PRIOR TO DISCHARGE TO TANKS USED FOR RE-USE
 -  BELOW GROUND WSD STORAGE TANK CONTRACTED OF ACO STORAGE BRICK OR EQUAL MODULAR TANK SYSTEM
 -  BELOW GROUND WSD STORAGE TANK CONSTRUCTED OF INSITU FORMED CONCRETE

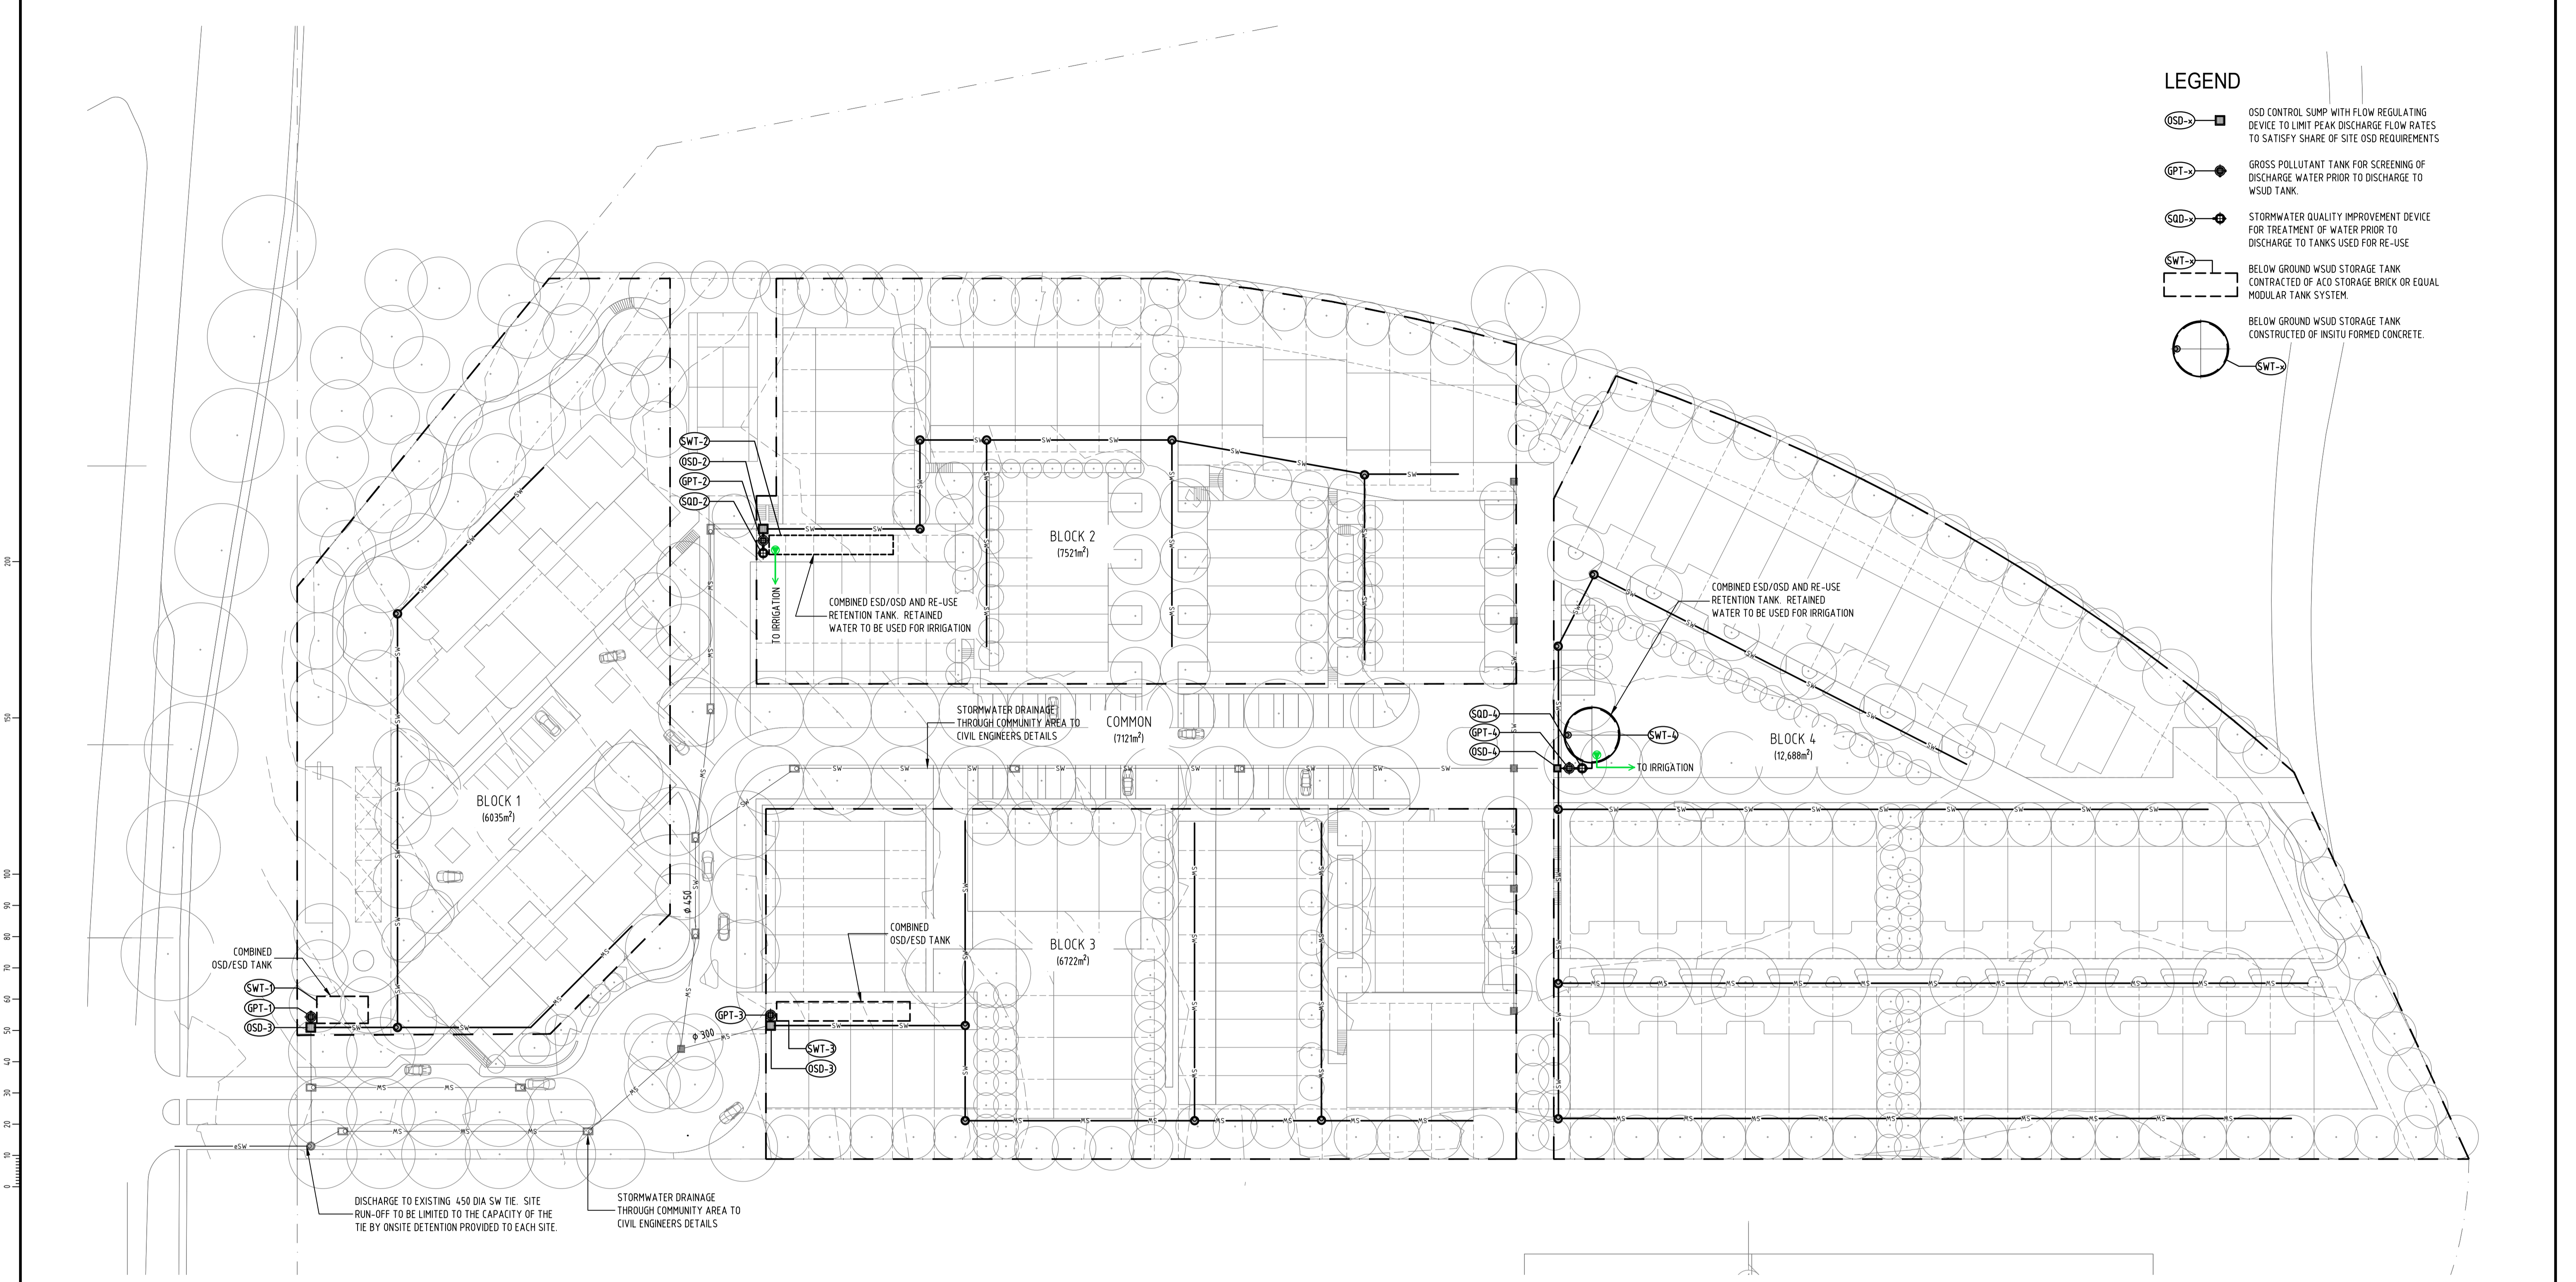

THE WSD CONCEPT DESIGN HAS BEEN PREPARED IN COMPLIANCE WITH THE ACT WSD GENERAL CODE AND THE ACT MULTI UNIT HOUSING DEVELOPMENT CODE AGAINST THE MANDATORY CRITERIA OF

- R86: WATER CONSUMPTION REDUCTION
- R87: ONSITE WATER RETENTION
- R88: SW POLLUTION REDUCTION
- R89: SW RUN-OFF MANAGEMENT.

REFER TO DRAWING NUMBER H002 FOR EVIDENCE OF COMPLIANCE AGAINST ALL ITEMS

A1 SHEET

No.	REVISION/ISSUE	DATE	BY	CHECKED	No.	REVISION/ISSUE	DATE	BY	CHECKED
4	WORKS APPROVAL ISSUE	23.01.19	DNT	DNT					
3	DCP AND CONCEPT PLAN ISSUE	03.09.18	DNT	DNT					
2	PRELIMINARY AMENDED MASTERPLAN ISSUE	28.08.18	DNT	DNT					
1	MASTERPLAN ISSUE	14.12.16	APT	DNT					

DOMA

THCS
TENNANT HYDRAULIC CONSULTING SERVICES

UNIT 1.03/109 TENNANT STREET
FYSHWICK ACT, 2696
PH: (02) 8285 2599
WEB: www.thcs.com.au
ABN: 28 825 484 093

PROJECT
SECTION 38 CAMPBELL

DRAWN: APT, DESIGNED: DNT, CHECKED: DNT

BLOCK: 435 SECTION: 38 SUBURB: CAMPBELL

DRAWING
HYDRAULIC SERVICES SW MANAGEMENT PLAN

File Name: TH180036-WA-H0100W DATE: AUG'18 SCALE: 1:500 @ A1, 1:1000 @ A3

PROJECT: TH180036 DWG No: H001 REV: 4 STATUS: PRELIMINARY